

GRIDPRO Interchangeable Plates

Product Range

GRIDPRO Interchangeable Plates

CL20509	9 Gang Metal Clad Grid Plate
CL20509B	9 Gang Metal Clad Grid Plate (No Knockouts In Back Box)
CL20512	12 Gang Metal Clad Grid Plate
CL20512B	12 Gang Metal Clad Grid Plate (No Knockouts In Back Box)
GR20400	3 - 4 Module Yoke
WA518	3 Gang Triple Row K/O Box 47mm Deep




CL20509, CL20509B



CL20512, CL20512B



GR20400

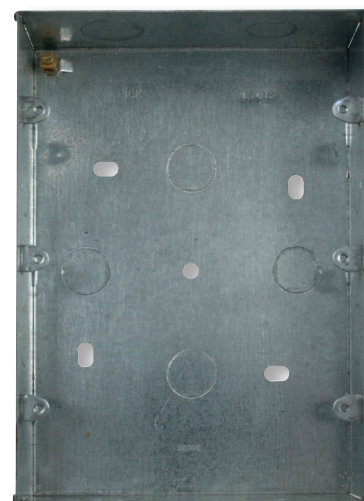

WA518 (Optional)



Errors & Omissions excluded. Specification is subject to change without notice. GR20400 to be used with all plate sizes. Provided with 40mm deep back boxes.

V1.0

Scolmore International Ltd, 1 Scolmore Park, Landsberg, Lichfield Road Ind. Estate, Tamworth, Staffordshire, B79 7XB

Telephone: 01827 63454


E-mail: sales@scolmore.com, technical@scolmore.com

Facsimile: 01827 63362

Website: www.scolmore.com

GRIDPRO Interchangeable Plates

Product Dimensional Drawings (mm)

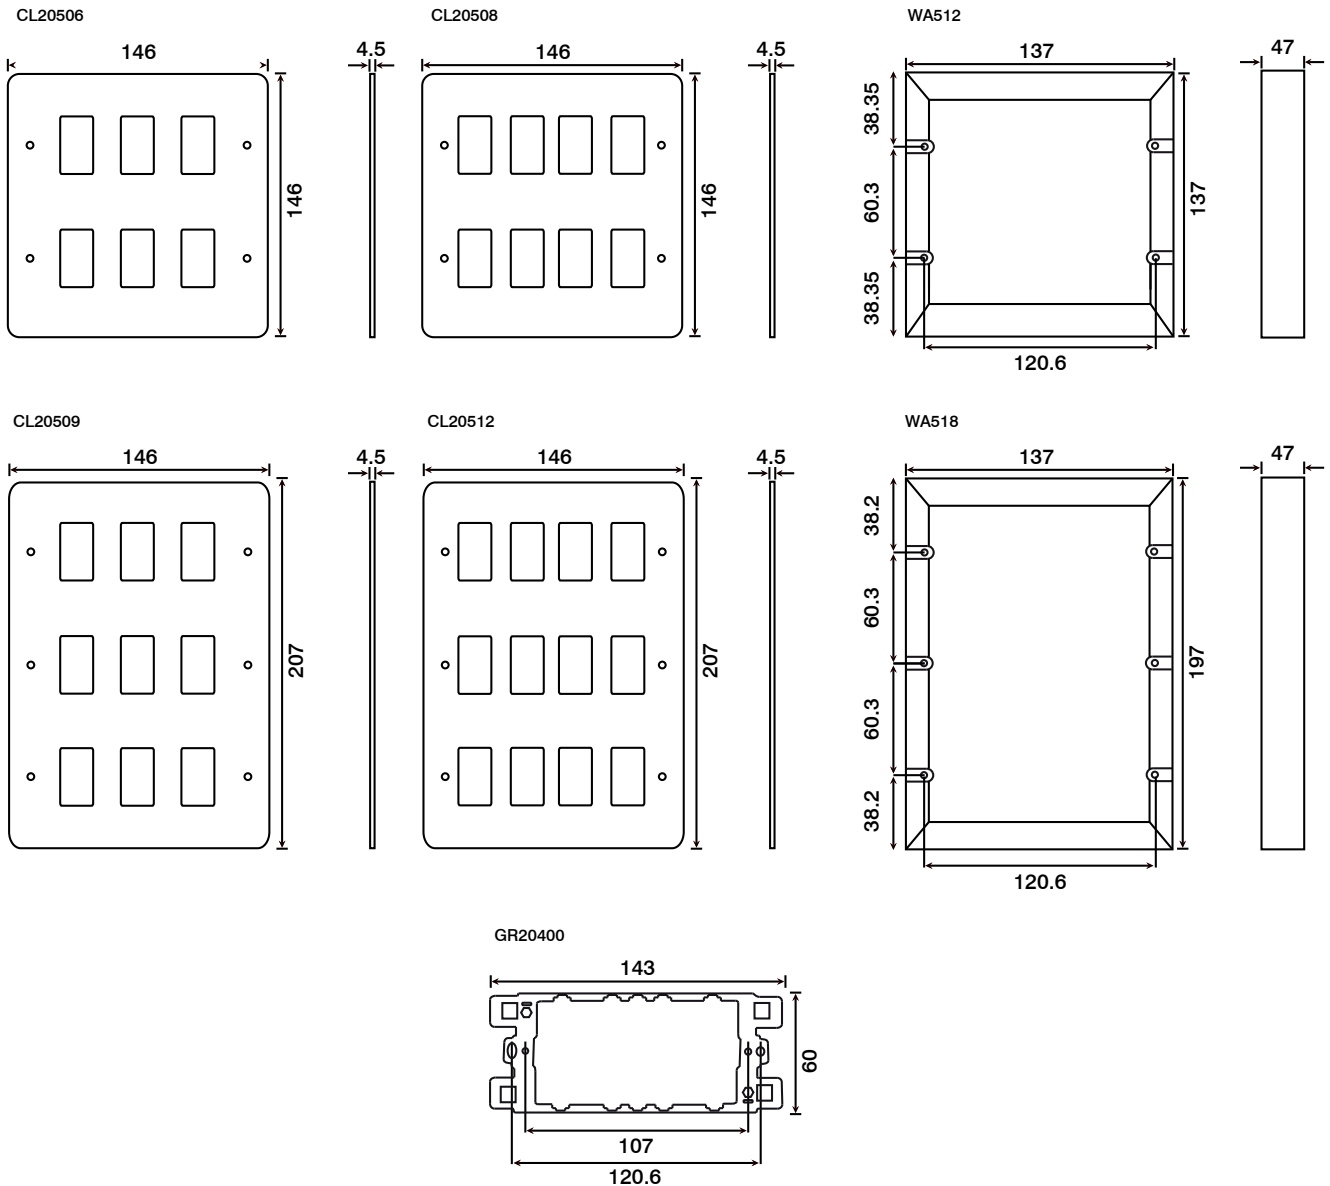

GRIDPRO Interchangeable Plates

Technical Specification

GRIDPRO Interchangeable Plates

Material Composition	Front Plate & Back Box: Electrophoretically Coated Steel
	GR20400 & GR20600 Mounting Yoke: Galvanised Steel
	Earth Terminal: Brass, Earth Strap: Mild Steel
	Back Boxes: Electrophoretically Coated Steel
Cable Size	Dependent on modules fitted
Back Box Depth	40mm Provided / 56mm Provided (CL20518 & CL20524)
Knockout Sizes	5 x 20mm (1 Gang), 7 x 20mm (2 Gang)
	4 x 20mm, 4 x 25mm (CL20506 & CL20508)
	5 x 20mm, 5 x 25mm (CL20509 & CL20512)
	3 x 20mm, 9 x 25mm (CL20518)
	6 x 20mm, 6 x 25mm (CL20524)
Modular	Yes
Warranty	10 Years
IP Rating	IP20
Operational Temperature	-5° to +40°C
Standards	BS 5733 : 2010 + A1 : 2014, BS 4662: 2006 + A1: 2009

Additional Information

Ensure that the mains supply is isolated before commencing installation and refer to the circuit diagram with the relevant product.

Bare earth cables must always be covered with appropriate sleeving and wired to the earth terminal.

CL20506 & CL20508 requires (2x) GR20400 3-4 Module Mounting Yokes. These plates are designed to be used with specified back box WA512 when flush mounting is required. 40mm back box supplied.

CL20509 & CL20512 requires (3x) GR20400 3-4 Module Mounting Yokes. These plates are designed to be used with specified back box WA518 when flush mounting is required. 40mm back box supplied.

CL20518 requires (3x) GR20600 6 Module Mounting Yokes. These plates are designed to be used with specified back box WA20518 when flush mounting is required. 56mm back box supplied.

CL20524 requires (4x) GR20600 6 Module Mounting Yokes. These plates are designed to be used with specified back box WA20524 when flush mounting is required. 56mm back box supplied.

Interchangeable with modules in the GRIDPRO system. 

Errors & Omissions excluded. Specification is subject to change without notice.

V1.0

Scolmore International Ltd, 1 Scolmore Park, Landsberg, Lichfield Road Ind. Estate, Tamworth, Staffordshire, B79 7XB

Telephone: 01827 63454

E-mail: sales@scolmore.com, technical@scolmore.com

Facsimile: 01827 63362

Website: www.scolmore.com



EU DECLARATION OF CONFORMITY

1. *Issuer Name* Scolmore International Limited
2. *Issuer Address* 1 Scolmore Park, Landsberg,
Lichfield Road Industrial Estate,
Tamworth, Staffordshire, B79 7XB
3. *Object(s) of Declaration* Essentials Range
 - a. *Group* GRIDPRO Interchangeable Plates
 - b. *Models No.* CL20401, CL20401B, CL20402, CL20402B, CL20403, CL20403B,
CL20404 CL20404B, CL20506 CL20506B, CL20508, CL20508B,
CL20509, CL20509B, CL20512, CL20512B, CL20518, CL20518B,
CL20524, CL20524B
4. *The object of the declaration described above is in conformity with the requirements of the following Legislations:*
5. *All products contained within the aforementioned comply with the relevant standards and requirements listed below.*

BS 5733 : 2010 + A1 : 2014
6. *I hereby declare that the equipment named above has been designed to comply with the relevant sections of the above referenced specifications. The unit complies with all applicable Essential Requirements of the Directives.*

In conjunction with the above all manufacture and process controls are in accordance with ISO 9001:2008.

This declaration has been issued under the sole responsibility of the manufacturer, signed at, for and on behalf of: Scolmore International Limited

R Turner

Ross Turner - Technical Support Engineer