

10AX Switch Modules



10AX Switch Modules



The New Media Modules offer a flexible build solution to a host of individual power socket outlet requirements. The clip fit grid modules are simple to install in their blank mounting plates.

10AX Switch Modules


Product Range

10AX Switch Modules

MM002**	10AX 2 Way Switch Module
MM025**	10AX Intermediate Switch Module




MM002WH

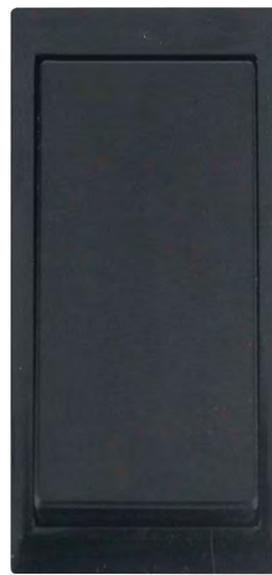

MM025BK

Product Dimensional Drawings (mm)

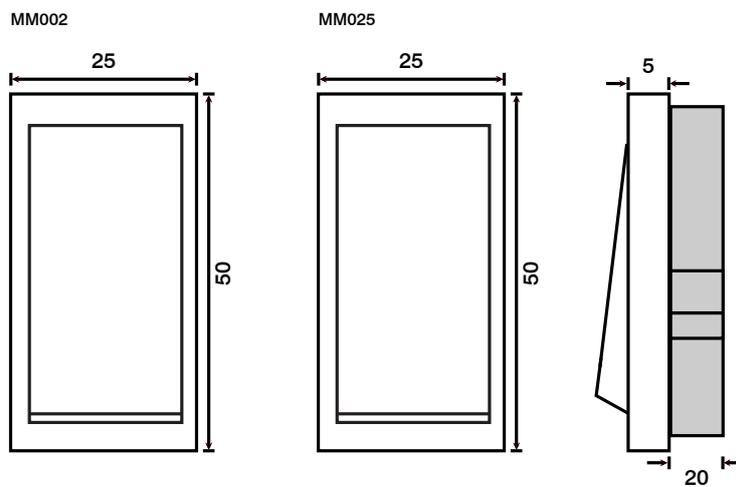

Errors & Omissions excluded. Specification is subject to change without notice. ** Denotes Module Colour

V1.0

Scolmore International Ltd, 1 Scolmore Park, Landsberg, Lichfield Road Ind. Estate, Tamworth, Staffordshire, B79 7XB

Telephone: 01827 63454

E-mail: sales@scolmore.com, technical@scolmore.com


Facsimile: 01827 63362

Website: www.scolmore.com


10AX Switch Modules

Wiring Diagram


1 Way Switched Circuit

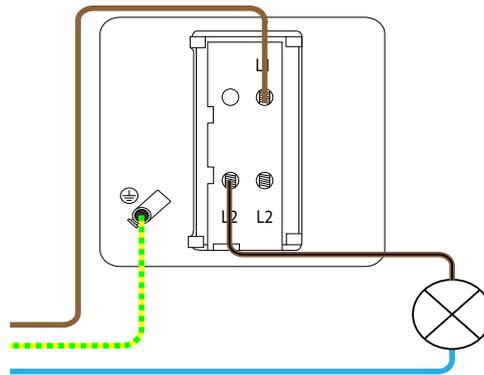

2 Way Switched Circuit

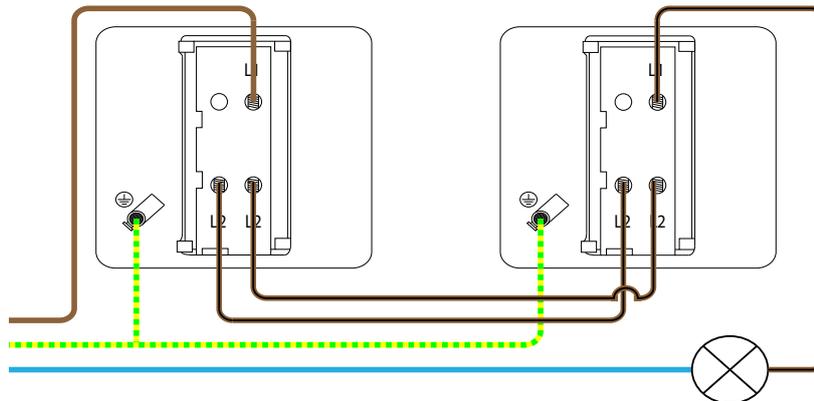

Intermediate Switched Circuit

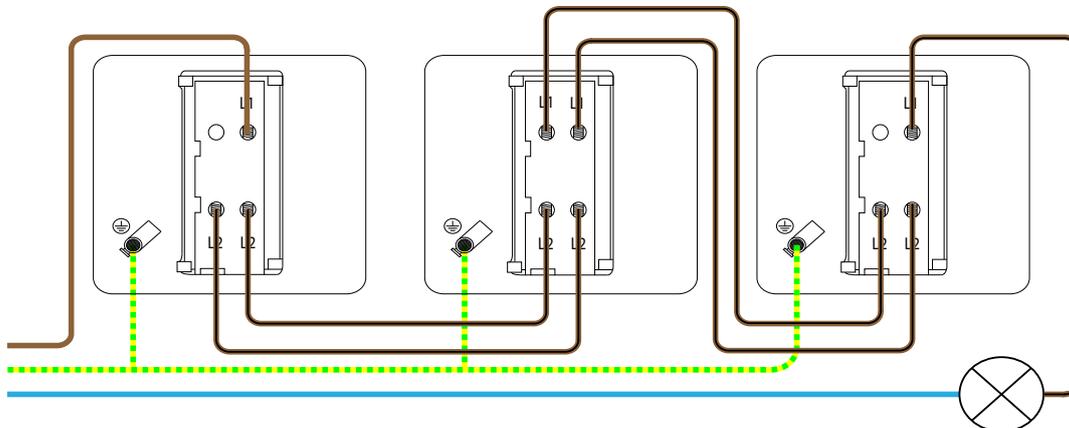

Errors & Omissions excluded. Specification is subject to change without notice.

V1.0

Scolmore International Ltd, 1 Scolmore Park, Landsberg, Lichfield Road Ind. Estate, Tamworth, Staffordshire, B79 7XB

Telephone: 01827 63454

E-mail: sales@scolmore.com, technical@scolmore.com

Facsimile: 01827 63362

Website: www.scolmore.com

10AX Switch Modules

Technical Specification

10AX Switch Modules

Material Composition	Module: Polycarbonate Rear Housing: Nylon Terminal: Brass Terminal Screws: Steel & Yellow Passivated
Voltage	240V~ 50Hz
Current Rating	10AX (Suitable for Inductive Loads)
Terminal Size	5mm ø
Torque Value	1.2 Nm
Cable Size	4 x 1.5mm ² or 2 x 2.5mm ²
Back Box Depth	25mm - 47mm (Dependant on Mounting Plate Used)
Module Size	Single Width (25mm x 50mm)
Modular	Yes
Warranty	1 Year
IP Rating	IP20
Operational Temperature	-5° to +40°C
Standards	BS EN 60669-1:1999 + A1:2002 + A2:2008

Additional Information

Standard Euro Module Size.

Ensure that the mains supply is isolated before commencing installation and refer to the circuit diagram with the relevant product.

Bare earth cables must always be covered with appropriate sleeving and wired to the earth terminal.



DECLARATION OF CONFORMITY

1. *Issuer Name* Scolmore International Limited
2. *Issuer Address* 1 Scolmore Park, Landsberg,
Lichfield Road Industrial Estate,
Tamworth, Staffordshire, B79 7XB
3. *Object(s) of Declaration* New Media Range
 - a. *Group* 10AX Switch Modules
 - b. *Model No.* MM002, MM025
4. *The object of the declaration described above is in conformity with the requirements of the following Legislations:*
5. *All products contained within the aforementioned comply with the relevant standards and requirements listed below.*

EN 60669-1:1999 + A1:2002 + A2:2008

6. *I hereby declare that the equipment named above has been designed to comply with the relevant sections of the above referenced specifications. The unit complies with all applicable Essential Requirements of the Directives.*

In conjunction with the above all manufacture and process controls are in accordance with ISO 9001:2008

Signed, for and on behalf of: Scolmore International Limited

Steven Bettson BSc - Senior Technical Support Engineer

CE 15