



## 45A Cooker Switches



The Click MODE range has recently been expanded to include a range of anthracite grey finished accessories to comply with current Building Regulations Part M.

Part M 45A Cooker Switches and socket outlets are designed to fit effortlessly with the range, with simple installation to enhance the décor of any area.

**45A Cooker Switches**

**Product Range**

**45A Cooker Switches**

<b>CMA500AG</b>	45A 1 Gang Single Cooker Switch
<b>CMA501AG</b>	45A 1 Gang Single Cooker Switch with Neon




CMA500AG




CMA501AG

**45A Cooker Switches**

**Product Dimensional Drawings (mm)**

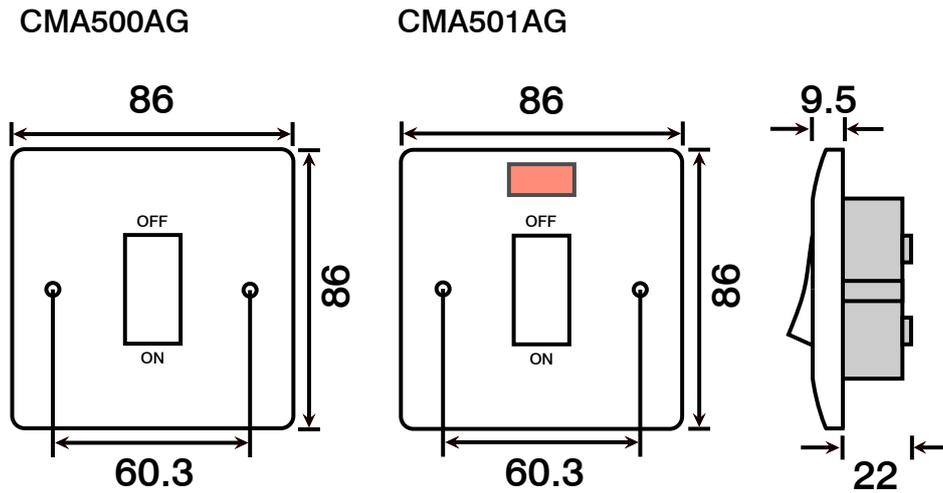

**Wiring Diagrams**

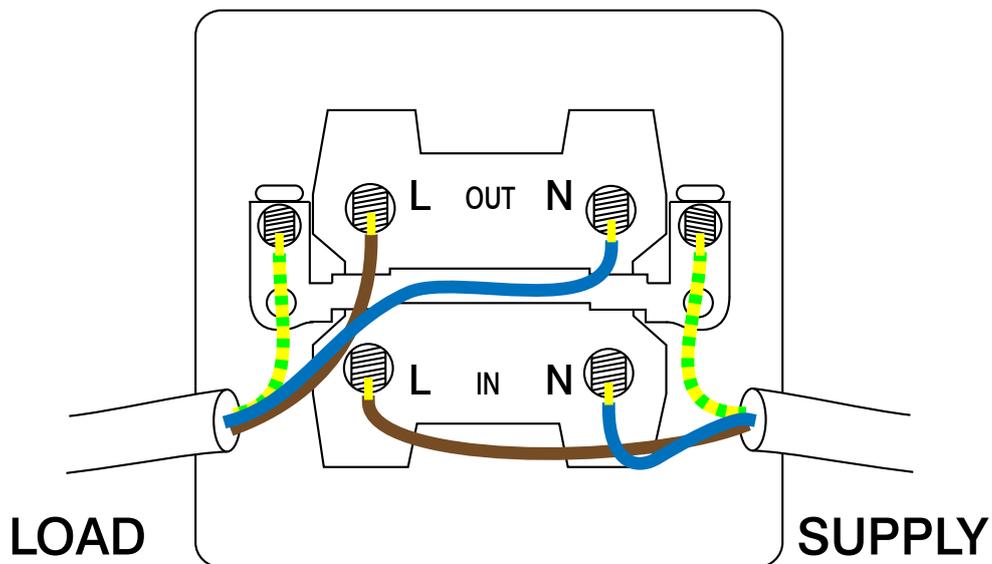

## 45A Cooker Switches

### Technical Specification

#### 45A Cooker Switches

<b>Material Composition</b>	Front Plate, Rocker Switch & Rear Housing: Urea Terminals: Brass Terminal Screws: Steel & Yellow Passivated Internal Mechanism: Formed Press Brass Silver “on-lay” Copper / Brass Contacts
<b>Voltage</b>	240V~ 50Hz
<b>Current Rating</b>	45A
<b>Terminal Size</b>	6mm ø
<b>Torque Value</b>	2.5Nm
<b>Cable Size</b>	4 x 4mm <sup>2</sup> , 3 x 6mm <sup>2</sup> or 1 x 10mm <sup>2</sup>
<b>Double Pole</b>	Yes
<b>Twin Earth</b>	Yes
<b>Back Box Depth</b>	35mm - 47mm
<b>Warranty</b>	20 Years
<b>Anti Microbial Certified</b>	Yes
<b>LRV Value</b>	8.9
<b>IP Rating</b>	IP20
<b>Operational Temperature</b>	-5° to +40°C
<b>Standards</b>	The Low Voltage Directive 2006/95/EC, Modified ISO 22196 EN 60669-1:1999 + A1:2002 + A2:2008 (BS EN 60669-1:2000)

### Additional Information

Ensure that the mains supply is isolated before commencing installation and refer to the circuit diagram with the relevant product.

Bare earth cables must always be covered with appropriate sleeving and wired to the earth terminal.

All white moulded accessories are manufactured using Urea Formaldehyde, which has similar inherent properties to antimicrobial additives that inhibit the growth of infectious diseases. All products were independently tested and achieved a 99.9% kill rate across all four types of the strains of bacteria - MRSA, E-Coli, Salmonella, and Klebsiella Pneumoniae.

# Part M Range

## DECLARATION OF CONFORMITY

1. *Issuer Name* Scolmore International Limited
2. *Issuer Address* 1 Scolmore Park, Landsberg,  
Lichfield Road Industrial Estate,  
Tamworth, Staffordshire, B79 7XB
3. *Object(s) of Declaration* Part M Range
- a. *Group* 45A Switches
- b. *Model No.* CMA500AG, CMA501AG
4. *The object of the declaration described above is in conformity with the requirements of the following Legislations:*
- | Document No | Title                 |
|-------------|-----------------------|
| 2006/95/EC  | Low Voltage Directive |

5. *All products contained within the aforementioned comply with the relevant standards and requirements listed below.*

BS EN 60669-1 : 1999 + A1 : 2002 + A2 : 2008 (BS EN 60669-1 : 2000)

6. *I hereby declare that the equipment named above has been designed to comply with the relevant sections of the above referenced specifications. The unit complies with all applicable Essential Requirements of the Directives.*

*In conjunction with the above all manufacture and process controls are in accordance with ISO 9001:2008*

Signed, for and on behalf of: Scolmore International Limited



Steven Bettson BSc - Senior Technical Support Engineer

# CE 15