

LPCSMP66

Weather Proof Microwave Presence Detector - wall mounted

Overview




The LPCSMP66 microwave presence detector is designed to provide automatic control of lighting, heating or ventilation loads. The LPCSMP66 detects movement using a highly sensitive microwave detector. This works by emitting low power microwave signals and measuring the reflections as the signals bounce off moving objects. The LPCSMP66 is optimised for wall mounting applications to give detection over long distances.

When movement is detected the load is turned on. When an area is no longer occupied the load will switch off after an adjustable time out period.

The internal light sensor provides additional energy saving in lighting applications. When an area is occupied lighting is only switched on when the level of natural light is below a preset level.

Features

Fig 1: Front features

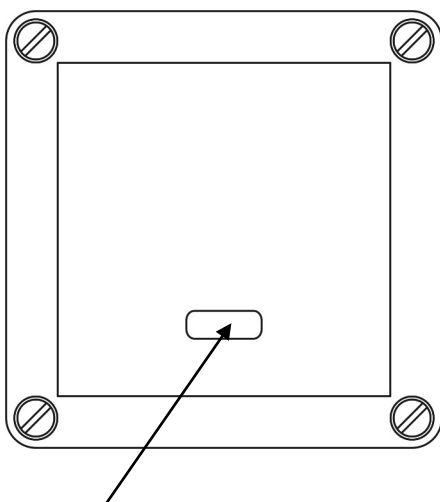

Sensor Lens
which covers...

IR Receiver
Light Level Sensor
Status LED

Microwave Sensor

Detects movement within the unit's detection range, allowing load control in response to changes in occupancy.

IR Receiver

Receives control and programming commands from an IR (infrared) handset.

Light Level Sensor

An integral adjustable photocell allows the lights to be kept off if there is sufficient ambient light.

Presence detection


When movement is detected the load will automatically turn on. When the area is no longer occupied the load will automatically switch off after an adjustable time period.

Status LED

The LED flashes Red to indicate the following:

| | |
|-------------------------------|---------------------------|
| Walk Test LED active | when movement is detected |
| Valid setting received | |

Wiring

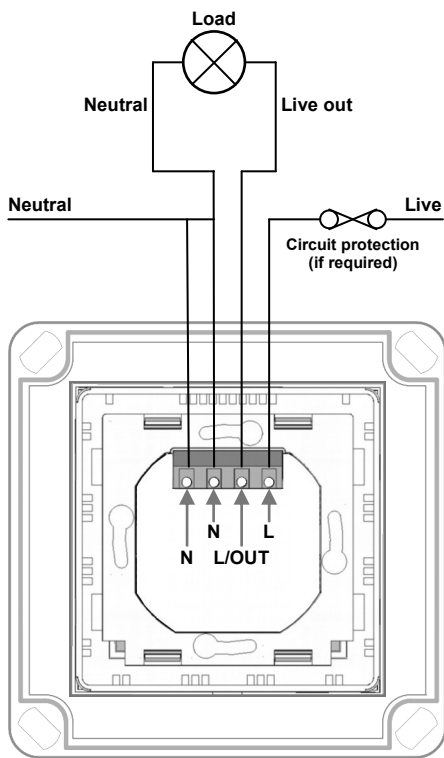

To switch from more than one position simply wire two or more units in parallel to achieve two way and intermediate switching.

The detector should be sited so that the occupants of the room fall inside the detection pattern shown overleaf, at a recommended height of 1.2m to 1.5m for wall sensors. Note that the higher the sensor is installed the shorter the detection range will be.

- Do not site within 1m of any lighting or ventilation equipment.
- Do not fix to a vibrating surface.
- Site as far away as possible from the surface of metal objects.
- Ensure that all cable entry to the enclosure is via suitable cable glands and seal with silicone sealant where appropriate.
- If it is necessary to screw through the rear of the enclosure ensure that any holes are covered with the caps provided and sealed with silicone sealant where appropriate.
- Note: when externally mounted the unit may be triggered by trees, animals, leaves etc.

Fault finding

What if the load does not turn ON?

- Check to see if the live supply to the circuit is good. For the LPCSMP66 version only: strap across the *L* and *LIVE OUT* terminal to turn the load on.
- If the supply and wiring are good, check the LUX level setting. Increase the LUX level setting to allow the controller to turn on at higher ambient natural light level.

What if the load does not turn OFF?

- Ensure that the area is left unoccupied for a greater time period than the time out period set using the switch.
- Make sure that the sensor is not adjacent to vibrating surfaces or objects (e.g. ventilation equipment).
- The unit may pick up movement through thin partitions or walls. Reduce the sensitivity.




The functionality of the LPCSMP66 is controlled by a number of parameters which can be changed or programmed. For most basic programming operations the LPUHC handset can be used and the following procedures are based on using this device. Point the handset at the Sensor and send the required programming commands to the unit as shown below.

Valid commands will be indicated by a red LED flash. See page 1 for details of other LED responses. *Note: other functions on the LPUHC which are not shown below are not applicable to this product.*


| Parameter Name | Default Value | Number of Shift key presses | | | | LPUHC Handset Graphics | Description |
|-------------------------------------|---------------|-----------------------------|----------------------|----------------------|----------------------|------------------------|--|
| | | 0 SHIFT 1 SHIFT 2 | 1 SHIFT 1 SHIFT 2 | 2 SHIFT 1 SHIFT 2 | 3 SHIFT 1 SHIFT 2 | | |
| Button Activation | | | | | | | |
| On / Raise | | On | | | | | Turn lights on. |
| Off / Lower | | Off | | | | | Turn lights off. |
| Walk test | Off | On | Off | | | | When set to On this causes a red LED to flash on the sensor when it detects movement. Use this feature to check for adequate sensitivity levels. |
| Time Out (Time adjustment) | 10 mins | 1, 10 & 20 minutes | 5, 15 & 30 minutes | | | | Once the detector is turned on, this value sets how long the lights will stay on once movement has ceased. |
| Lux on level (Switch level on) | 9 | 2, 5 & 7 | 4, 6 & 9 | | | | Lux level setting to prevent the luminaires being switched on if the ambient light level is sufficient (adjustable between 1 and 9). The luminaires will always be switched on at level 9. |
| Lux off level (Switch level off) | 9 | 2, 5 & 7 | 4, 6 & 9 | | | | Lux level setting to switch the luminaires off during occupancy if the ambient light level goes above the setting (adjustable between 1 and 9). Level 9 will always keep the lights on. This setting can be used for "window row switching". |
| Sensitivity | 9 | 1, 5 & 9 | 3, 6 & 8 | | | | Sensitivity level for detecting movement. 1 = low sensitivity 9 = high sensitivity |
| Defaults | | | | D | | | Returns the unit to the default settings. |
| Shift | | | | | | | Use this button to select the settings in red and blue signified by the 'Shift 1' and 'Shift 2' LEDs |

Detection pattern

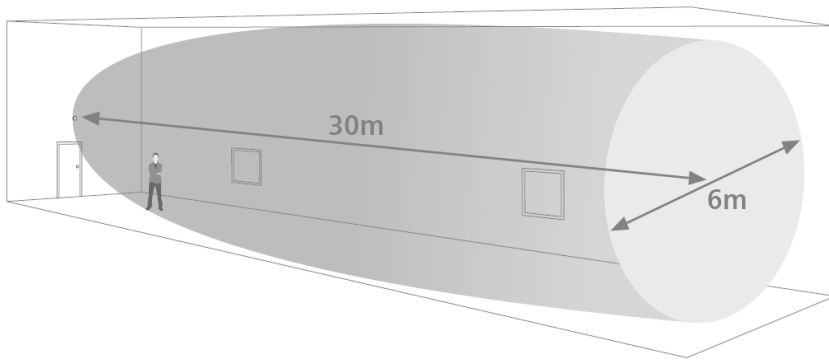

Area of high sensitivity  Area of lower sensitivity 

Dimensions

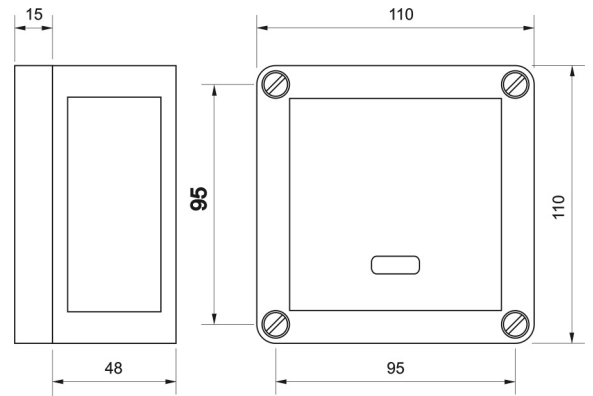

Technical data

| | |
|-------------------|--|
| Supply Voltage | 230VAC +/- 10% |
| Frequency | 50Hz |
| Power consumption | On 1.15W Off - 790mW |
| Weight | Load 10A of lighting and or ventilation including incandescent, fluorescent, compact fluorescent, low voltage (switch primary of transformer). |
| Terminal Capacity | 0.25kg |
| Time out period | 2.5mm ² |
| Light level | Adjustable 10 seconds to 99 minutes. |
| Fixing method | Optional adjustment by using IR programming handsets. |
| Temperature | Surface fixing by screws (not supplied) . |
| Humidity | -10°C to 35°C |
| Material (casing) | 5 to 95% non-condensing |
| IP rating | Polystyrene Type Class 2 |
| Compliance | IP 66 |
| Safety | EMC-2004/108/EC LVD-2006/95/EC |



Part numbers

| | Part number | Description |
|--------------------|-------------|--|
| Detector | LPCSMP66 | Weatherproof microwave presence detector (wall mounting) |
| Accessories | LPCUHC | Programming IR handset |

IMPORTANT NOTICE!

This device should be installed by a qualified electrician in accordance with the latest edition of the IEE Wiring Regulations and any applicable Building Regulations.

LUCECO

Stafford Park 1
Telford
Shropshire
TF3 3BD
United Kingdom
Tel: +44 (0)1952 238 100
Fax: +44 (0)1952 238 180
www.luceco.co.uk
sales@luceco.co